



# Inexpensive Nitrification via Side Stream Treatment and Main Stream Bioaugmentation

A photograph of a mobile water treatment unit, a white trailer with a blue door, parked on a gravel lot. The trailer has the 'InNitri' logo and 'COMBINATION' written on it. In the foreground, there are several blue and white barrels. Overlaid on the bottom left of the photo are two technical diagrams. The first is a line graph titled 'Comparison of loading of Nitrosens and the effect on Nitrosens' showing 'Nitrosens Concentration (mg/L)' on the y-axis (0 to 120) and 'Time (hours)' on the x-axis (0 to 5). It features two curves: a red one that rises and a blue one that falls. The second diagram is a flowchart of the 'InNitri' process, showing the flow from 'Influent' through 'Pre-treatment' to 'Side Stream Treatment' and 'Main Stream Bioaugmentation', with various chemical and biological components labeled. A red box with the text 'DR PETER KOS' is overlaid on the bottom left of the diagrams.

**DR PETER KOS**

- **A PROCESS WHICH REDUCES THE SRT REQUIRED FOR NITRIFICATION**
- New England WEA January 2001
- Mr. Alphonse Warakowski

• **ABSTRACT**

• The InNitri® nitrification process/flowsheet was developed to provide an inexpensive alternative for plants in the northern climates which need to upgrade their air or pure oxygen activated sludge process for year-round nitrification or nitrogen removal. In this process/flowsheet supplemental nitrifiers are added daily to the activated sludge process to replenish nitrifiers removed with the wasted activated sludge. The supplemental nitrifiers are grown in a separate small side-stream aeration tank using either ammonia available in the digested sludge dewatering liquid and in the digester supernatant or commercial ammonia. The paper presents a description of this process/flowsheet, the theoretical background and results of modeling, results of laboratory testing, and a cost evaluation to retrofit a typical wastewater treatment plant.

• **KEYWORDS**

• Activated sludge; low temperature nitrification; nitrification, supplemental nitrifiers; short solids retention time.

• **INTRODUCTION**

• The ability of the conventional activated sludge process to nitrify is highly temperature dependent. At low winter temperatures, nitrification can be sustained only if the activated sludge process is operated at relatively high solids retention time (SRT) values (for example at least 15 to 18 days SRT is used for designing nitrification at temperatures around 10°C if an effluent ammonia concentration of 2.0 mg/l is required). If the activated sludge process is operated at substantially lower SRT values the growth rate of nitrifying bacteria (nitrifiers) is lower than the daily wasting rate of nitrifiers discharged in the excess activated sludge and nitrifiers are washed-out of the system causing nitrification to cease. Therefore, to upgrade existing activated sludge plants for winter nitrification usually requires substantial enlargement of the aeration tank to allow operation at higher SRT values.


• This paper introduces InNitri®, a new nitrification process which allows nitrification at short SRT values, even at low winter temperatures and thus provides nitrification in a substantially smaller aeration tank than is currently required for conventional nitrification.

• **PROCESS FLOWSHEET DESCRIPTION**

• A schematic diagram of the InNitri® nitrification process/flowsheet is presented in Figure 1. (See Figure 1. "Flowsheet with in Plant Sludge Treatment") It consists of a typical secondary treatment plant (primary sedimentation, aeration tank, secondary clarification) with sludge thickening followed by anaerobic digestion and sludge dewatering. The upgrading of such a conventional plant to provide year-round nitrification using the short SRT nitrification process requires addition of a small aeration tank and clarifier for growing nitrifiers. In this system, the warm (typically 30 to 35°C) dewatering liquid containing a high ammonia content (between 300 to 900


mg/l) is mixed with a small portion of primary effluent (to adjust the temperature and provide BOD), and nitrified in the side-stream nitrification aeration tank. A portion of the resulting biological sludge, which contains a high percentage of nitrifiers, is continuously or periodically discharged into the main aeration tank and provides the main activated sludge process with supplemental nitrifiers.

• **FIGURE 1**  
• **Flowsheet with in Plant Sludge Treatment**

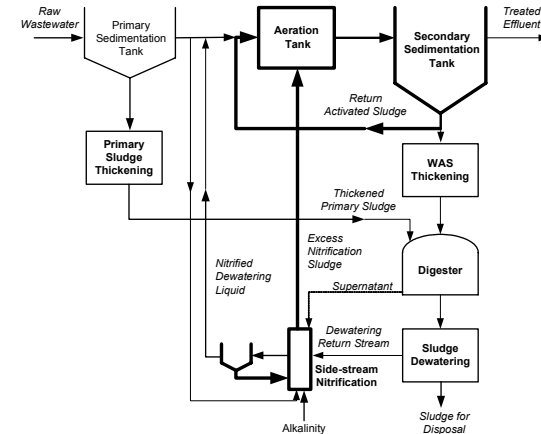

The same process can also be applied in plants without digesters, as shown in Figure 2. (See Figure 2 "Flowsheet without in Plant Sludge Treatment") In this case commercial ammonia is used instead of the dewatering return stream.

• **FIGURE 2**  
• **Flowsheet without in Plant Sludge Treatment**

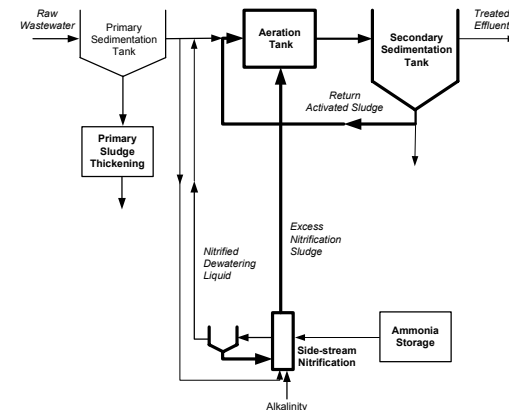


**THEORETICAL BACKGROUND**

To demonstrate the difference between the conventional nitrification process and nitrification with supplemental nitrifiers in the InNitri® process, KOS (1998) presented theoretical equations and results of modeling for a typical wastewater treatment plant. Modeling was carried out using the IAWPRC task group Activated Sludge Model No. 1. Figure 3 summarizes the difference for a complete mix steady-state aeration tank that has 6 hr hydraulic detention time, which operates at 10°C and receives an influent containing 25 mg/l of TKN and 25% of TKN is in the side-stream dewatering liquid. (See Figure 3 “Effluent Ammonia Nitrogen and Nitrifiers Concentration as a Function of SRT at 10°C.”)

For conventional nitrification this Figure 3 shows that as the operating SRT is decreased, the concentration of nitrifiers also decreases and ammonia nitrogen in the effluent increases. The minimum SRT at these conditions is reached at an SRT equal to 5.4 days when the nitrifiers concentration equals zero and the ammonia nitrogen effluent reaches the maximum value. For an SRT below 5.4 days, the rate of nitrifier growth is lower than the rate of nitrifiers wasted in the excess activated sludge, and nitrification cannot take place. To achieve an effluent ammonia concentration of 2.0 mg/l, one would have to operate this process at the theoretical SRT equal to 8.8 days. In practice, the minimum safety factor between 1.5 and 2.0 would be applied, yielding the design SRT between 13 to 18 days.

**FIGURE 3**

**Effluent Ammonia Nitrogen and Nitrifiers Concentration as a Function of SRT at 10°C**

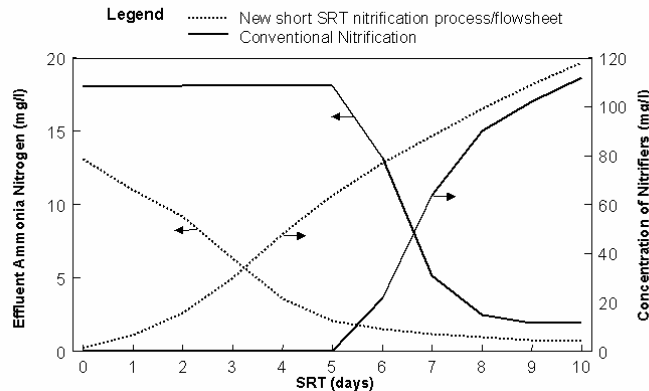


For the InNitri® process, where ammonia nitrogen from the dewatering liquid is first nitrified in the separate nitrification reactor, the concentration of nitrifiers is significantly higher at all sludge ages resulting in a much lower effluent ammonia concentration. In other words, to achieve the same effluent ammonia concentration, this new process/flowsheet can be operated at substantially lower SRT values. For example, to achieve an effluent ammonia concentration of 2.0 mg/l, the conventional nitrification would have to be operated at an 8.8 days SRT, while the new process/flowsheet would provide the same effluent ammonia if operated at an SRT of 5.1 days

•For design purposes, the safety factor of 1.5 to 2.0 is typically used in design for conventional nitrification yielding the design SRT between 13 to 18 days for 10°C temperature and a design effluent ammonia nitrogen concentration of 2.0 mg/l (SRT theoretical is 8.8 days, see Figure 3.). With this new process and the same safety factor of 1.5 to 2.0 a design SRT of 7 to 10 days is required to achieve a 2.0 mg/l effluent ammonia concentration at a winter temperature of 10°C.


• Figure 3 also demonstrates that nitrifiers are present in the main aeration tank at all SRT values. Nitrifiers cannot be washed-out from the aeration tank even if operated at lower SRT values and so partial nitrification takes place even at extremely low SRT values. In other words this process/flowsheet does not have minimum SRT under which nitrification would not occur and therefore it will be much more stable and may not need as high a safety factor as conventional nitrification.

•The above described example of modeling for a sewage temperature of 10°C was repeated at other temperatures from 7.5 to 20°C and results are summarized in Figure 4. (See Figure 4 “Design SRT as a Function of Temperature”) Figure 4 compares the design range of the SRT values, using the safety factor 1.5 to 2.0, for the conventional and the InNitri® process/flowsheet. The comparison shows that the new nitrification process/flowsheet requires significantly lower design SRT than the conventional nitrification to achieve the same effluent ammonia concentration. For the case where the design effluent ammonia concentration is 2.0 mg/l the required design SRT for the new process/flowsheet is only about 60% of that required for conventional nitrification.

• **FIGURE 4**  
• **Design SRT as a Function of Temperature**

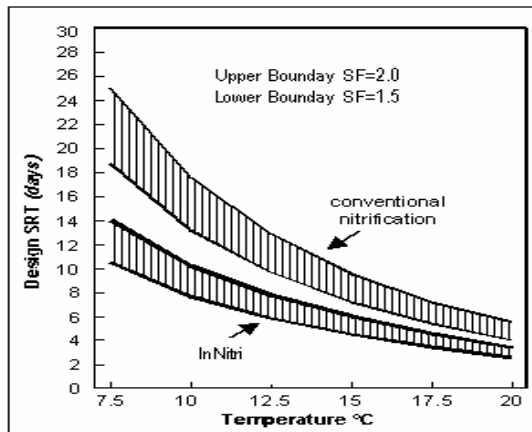

• **FIGURE 5**  
• **Reduction of Nitrification Rates**

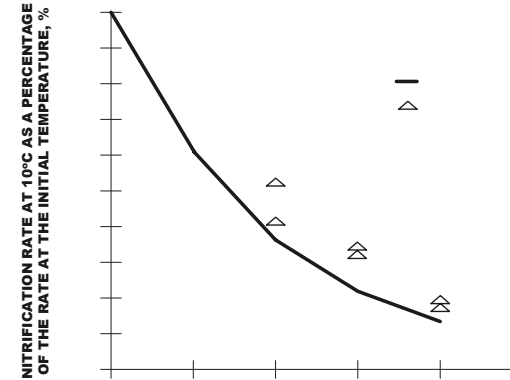

• **LABORATORY TESTING**

• The theoretical considerations assumed that nitrifiers generated at higher temperature will slow down their nitrification reaction rate according to a theoretical factor of  $e^{0.098(T-15)}$ ; where T=Temperature in degrees centigrade. To evaluate this effect a laboratory study was conducted at the Civil and Geological Department, University of Manitoba. In this study three 2.4 l chemostat reactors were operated at 20, 25, and 30°C respectively. The reactors were operated at SRT=5 days and pH was controlled by automatic pH controller at 7.2 units. Reactors were fed batchwise three times per day and maximum nitrification reaction rates were determined by sampling from reactors in 15 minute intervals following feeding. Samples were quickly filtered and analyzed for ammonia nitrogen, nitrites and nitrates. On two occasions samples of mixed liquor from these reactors were quickly cooled down to 10°C, fed with the same ammonia source and the maximum nitrification rates were determined using the same procedure.

• Figure 5 presents the nitrification rates at 10°C as a percentage of the nitrification rate at the initial temperature and compares them with the theoretical prediction using the  $e^{0.098(T-15)}$  factor. (See Figure 5 “Reduction of Nitrification Rates”).

• The nitrifiers grown at 20°C exhibited 47% and 59% reduction of the nitrification rate at 10°C. In comparison, theoretical reduction is 63%. The nitrifiers grown at 25°C exhibited 66% and 67% reduction of the nitrification rate at 10°C. In comparison, theoretical reduction is 77%. The nitrifiers grown at 30°C exhibited 81% and 83% reduction of the nitrification rate at 10°C. In comparison, the theoretical reduction is 86%. This measurement showed that the measured reduction of the nitrification rates was slightly less than the theoretical ones.

• **COMPARISON OF PROCESSES**

• Brinjac, Kambic and Associates have completed an analysis for upgrading an existing facility for nutrient control. The existing facility can be considered typical of many of the plants designed to meet the original requirements of the Federal Clean Water Act. The existing facility is located in the Northeastern United States. It is the principal point source contributor of nitrogen to a river which flows to an estuary which is undergoing eutrophication. The facility is site constrained with little room available for flow or process expansion. However the designers have to accomplish both of these tasks.

• The results of the analysis are shown in the following Table 1.

**TABLE 1**

COST ITEM	Conventional	InNitri	K-1	K-2	K-3	R-1	R-2
Construction	\$ 7,851,386	\$ 2,945,404	\$13,698,404	\$12,000,000	\$ 6,000,000	\$18,145,404	\$14,500,000
TOTAL PROJECT	\$10,599,371	\$ 3,976,295	\$18,826,295	\$16,200,000	\$ 8,100,000	\$24,496,295	\$19,575,000
Annual O&M	\$ 541,635	\$ 301,994	\$ 542,029	\$ 1,574,265	\$ 1,233,628	\$ 865,056	\$ 1,785,866
Cost per pound nitrogen removed	\$ 1.09	\$ 0.50	\$ 1.58	\$ 2.32	\$ 1.94	\$ 3.44	\$ 2.61
Decimal Percent Difference Compared to InNitri	2.18	1.00	3.16	4.64	3.88	6.88	5.22

**DEFINITION OF EVALUATED SYSTEMS**

Conventional	Expands the existing facility to create a Modified Ludzack Ettinger process configuration for total nitrogen control.
In-Nitri®	Utilizes the existing facility retrofitted to a modified Ludzack Ettinger process with an InNitri side stream reactor to convert nitrogen containing recycle streams into supplemental nitrifiers for the MLE.
K-1	Utilizes the proprietary BioStyr process in conjunction with the existing facility in a split flow parallel treatment mode of operation for total nitrogen control
K-2	Utilizes the existing facility as a high rate first step followed by BioStyr in a series mode of operation for total nitrogen control.
K-3	Utilizes the existing facility with Actiflow supplemented with polymers in the primaries, the existing facility at high MLSS for nitrification, followed by BioStyr in a series mode of operation for total nitrogen control.
R-1	Similar to Kruger 1 with split flow to the existing facility modified to MLE and two parallel trains of BioStyr all operated in a parallel mode of operation for total nitrogen control.
R-2	Utilizes the existing facility as a high rate first step followed by BioStyr for nitrification with fluidized beds for denitrification all operated in series mode of operation for total nitrogen control.

- Brinjac, Kambic and Associates have recommended that the facility proceed in implementing the InNitri® process for the following reasons:
  - Lowest cost per pound of nitrogen removed
  - Lowest capital cost
  - Lowest operating cost
  - Ability to implement future flow increases
  - Minimal site excavation needed for implementation
  - Amenability of construction sequencing to current plant operations
  - Operational simplicity
  - Washout protection for nitrifiers

- **CONCLUSIONS**

The InNitri® process has been mathematically modeled using the IAWPRC task group Activated Sludge Model number 1. A comparison of the sludge retention time necessary for nitrification using InNitri versus conventional nitrification shows significant reductions in costs for low temperature wastewaters. Research at the University of Manitoba indicates that the transport of nitrifying sludge from a warm sidestream reactor to a cold mainstream reactor should pose no process problems. An evaluation of the process to upgrade an operating plant shows significant savings versus conventional and other advanced nitrification processes.

- **ACKNOWLEDGEMENTS**

CREDITS: The author wishes to thank Ms. Melanie A. Head for her work on the effect of temperature change on the kinetics of nitrifying sludge cultures. The laboratory study conducted at Civil and Geological Department of University of Manitoba, MB, was sponsored by City of Winnipeg, MB, and Reid Crowther and Partners Ltd. The author wishes to thank Brinjac, Kambic and Associates for sharing the results of an engineering feasibility study which evaluated Nitrogen removal processes for a Northeast USA facility.

- **REFERENCES**

(1) Short SRT Nitrification Process/Flowsheet Wat.Sci.Tec. Vol38, No1, pp 23-29, 1998 IAWQ

(2) Changes in Nitrification Rates with Sudden Changes in Temperature: Its Implications to Short-SRT Systems Melanie Head, J. A. Oleszkiewicz, WCWWA November 5-8th Winnipeg, MB

(3) Engineering Feasibility Study as of 12/June/2000 by Brinjac, Kambic and Associates, Inc.

**ASK FOR  
REPORT ON PILOT PLANT RESULTS  
NUTRIENT REMOVAL UPGRADE**



**PIMA COUNTY WASTEWATER MANAGEMENT DEPARTMENT  
INA ROAD WATER POLLUTION CONTROL FACILITY**

**OCTOBER 2003 – JANUARY 2004**

**MIXING AND MASS TRANSFER TECHNOLOGIES, INC  
March 2004**

## NORTH AMERICAN CONTACTS and LOCATIONS

### Northeastern Region (including Canada)

Thomas Gilligan  
583 Greenhaven Road  
Pawcatuck, CT 06379

860-599-5381 FON office  
860-460-1973 FON mobile  
860-599-8073 FAX  
tgilligan@m2ttech.com

### Southeast Region (including Caribbean)

James Schlachter  
732 Howard's Loop  
Annapolis, MD 21401

410-216-9233 FON office  
410-570-3164 FON mobile  
410-268-4858 FAX  
jschlachter@m2ttech.com

### Midwestern Region (Including Canada)

Roger Gyger  
1012 Liberty Drive  
Naperville, IL 60540

630-983-7653 FON office  
630-430-9045 FON mobile  
630-983-7675 FAX  
rgyger@m2ttech.com

### Northern Western Region (Including Canada)

Irving Williams  
10874 Willow Reed Circle East  
Parker, CO 80134

303-981-3552 FON office  
303-981-3552 FON mobile  
303-841-2508 FAX  
iwlliams@m2ttech.com

### Southern Western Region (including Mexico)

Alphonse Warakowski  
8833 North Congress, s 818  
Kansas City, MO 64153

816-584-1969 FON office  
816-665-1931 FON mobile  
816-584-1970 FAX  
awarakowski@m2ttech.com

### North American Engineering and Service Center

Richard Johansen (Engineering)  
Jerome Warakowski (Service)  
Mixing and Mass Transfer Technologies LLC  
8 John Walsh Boulevard, Suite 423  
Peekskill, NY 10566  
914-734-7483 FON  
914-734-7487 FAX

### North American Research Center

Prakash Balan, PhD  
Brad Holzapfel, Duane Herr  
Mixing and Mass Transfer Technologies LLC  
2820 East College Avenue, suite M  
State College, PA 16801  
814-861-1234 FON  
814-861-3110 FAX

### Corporate Headquarters

John McWhirter PhD Managing Partner  
Barbara Villegas Executive Assistant  
Mixing and Mass Transfer Technologies LLC  
Post Office Box 315  
State College, PA 16804  
814-466-6994 extension 303 FON  
814-466-8761 FAX

**Operating Wastewater Process Plants  
Throughout North America**



**We have the Solutions for Pollution**  
**Hi-Flo II™ Aerators**  
**UNOX<sup>®</sup>, ATAD™, DDS™,**  
**LinPor™, InNitr<sup>®</sup>, SHARON™, and more**



*Formerly LOTEPRO Environmental Systems and Services*